


# City of Alcoa Electric Department Minimum Line Clearance Standards For Distribution Circuits

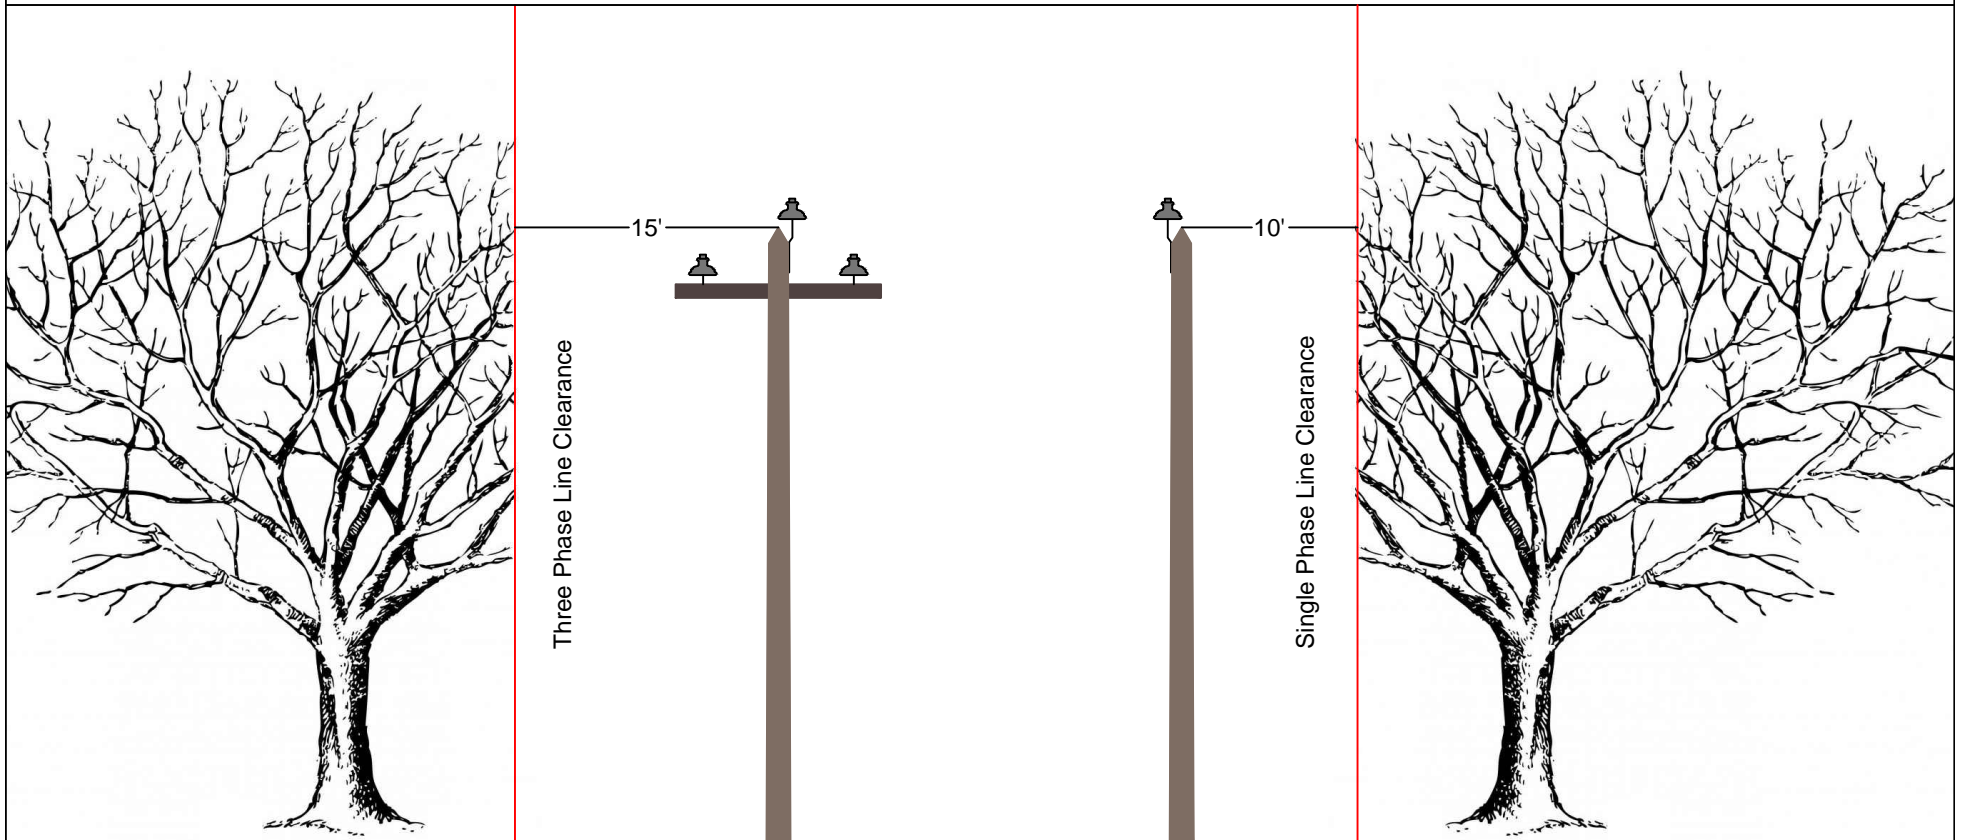

City of Alcoa Electric Dept. will utilize  
"ground to sky" trimming to maintain 15 feet of clearance from lines.